


EGRESS DOOR (R311.1/R311.2)

Not less than one, side-hinged exit door shall be provided for each dwelling unit and shall not require travel through a garage or carport. The door shall provide a minimum clear width of 32" measured between the face of the door and the stop when the door is opened at 90 degrees.

LANDINGS (R311.3)


The required exterior egress door must have a landing at least 3'x3' inside the door. On the outside of the door, the step down may be 8" max to the required 3' x 3' minimum landing. After the required landing there may be additional steps.

Other doors and stairs must have a top and bottom landing measuring at least 3'x3' (and not less than the width of the stairs) except that a landing is not required at the top of stairs if there is no door swinging over the steps.

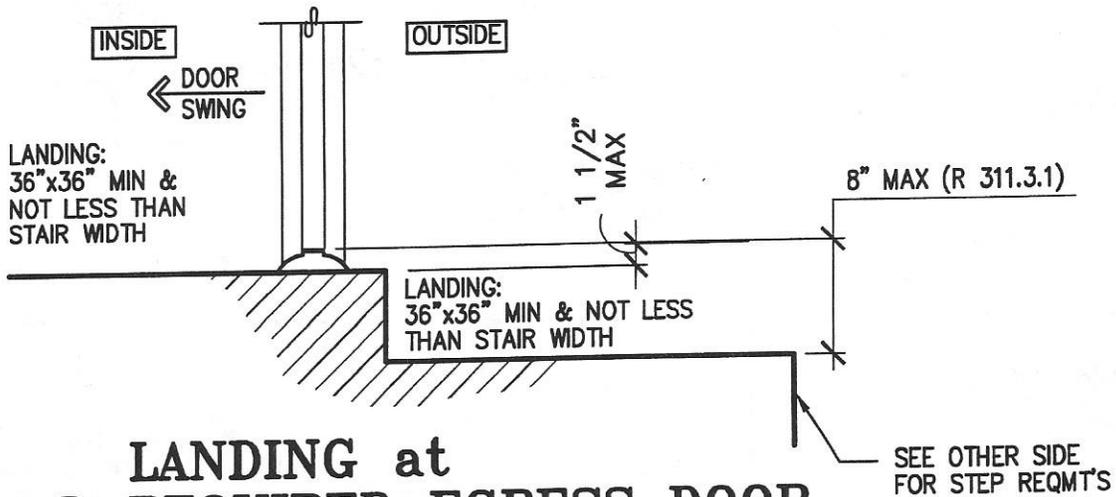

1 **LANDING at REQUIRED EGRESS DOOR**

SCALE: NTS

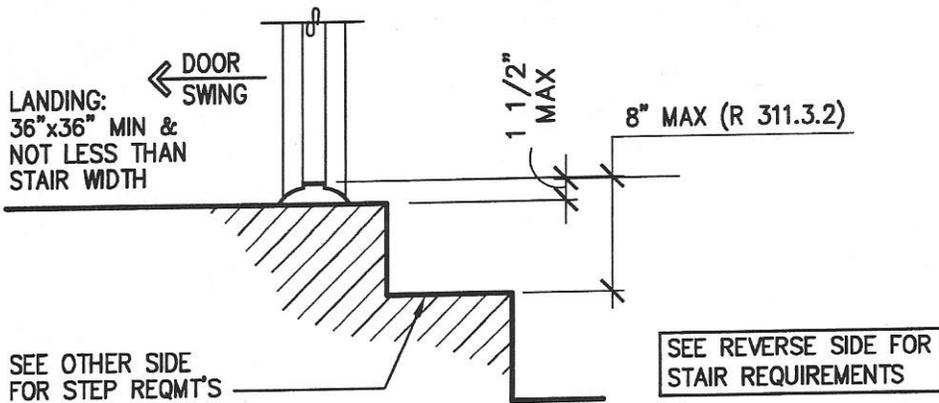

2 **LANDINGS at OTHER EXTERIOR DOORS AND TOP OF STAIRS**


SCALE: NTS





OREGON RESIDENTIAL SPECIALTY CODE
LANDINGS at DOORS & STAIRS

NOTES:

1. SEE ORSC SECTION R311 FOR ADDITIONAL INFORMATION.
2. OPEN RISERS SHALL NOT BE PERMITTED (EXCEPT OPENINGS LESS THAN 4")
3. 3/8" MAX VARIANCE IN RISERS, TREADS & NOSINGS.

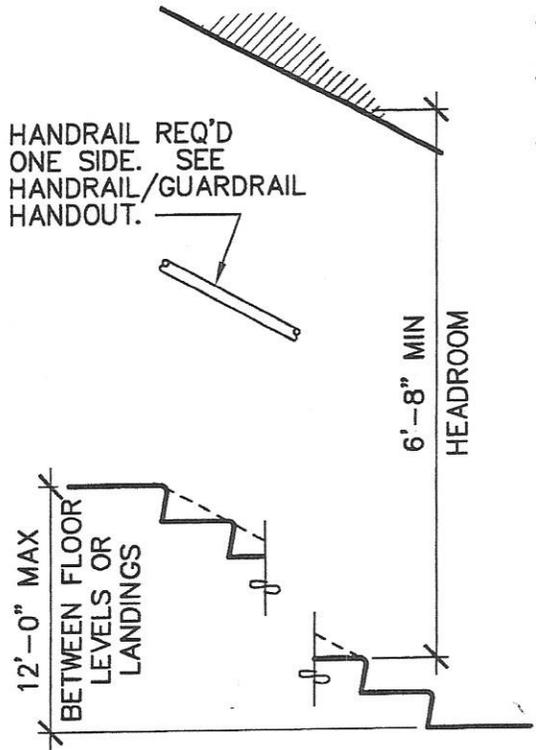


NOSING ARE REQUIRED ON TREADS LESS THAN 10"

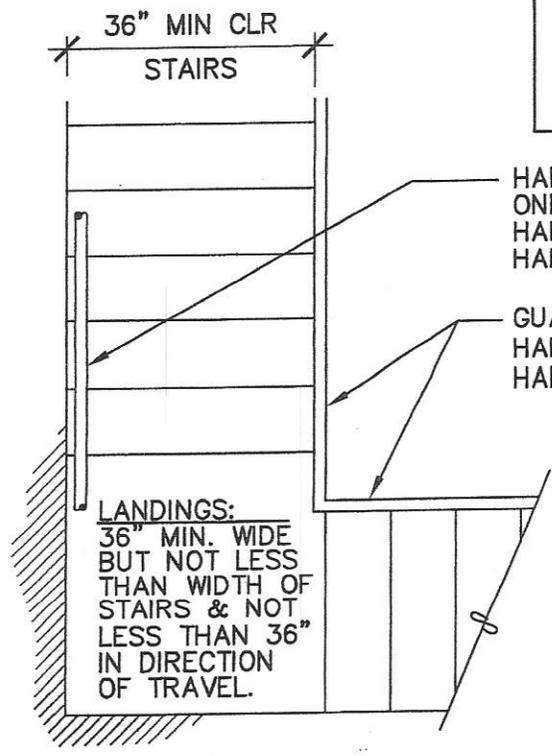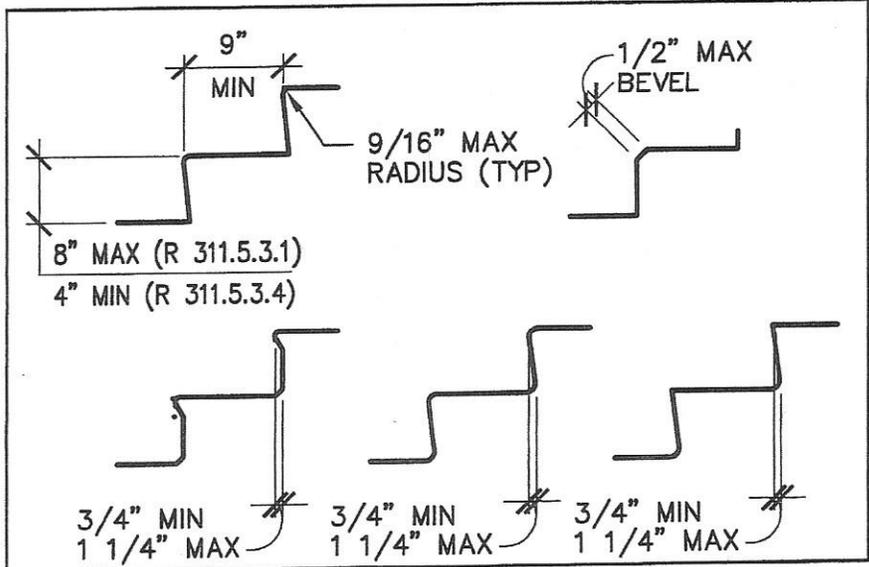

PLAN VIEW

HANDRAIL REQ'D ONE SIDE. SEE HANDRAIL/GUARDRAIL HANDOUT.

GUARDRAILS REQ'D. SEE HANDRAIL/GUARDRAIL HANDOUT.

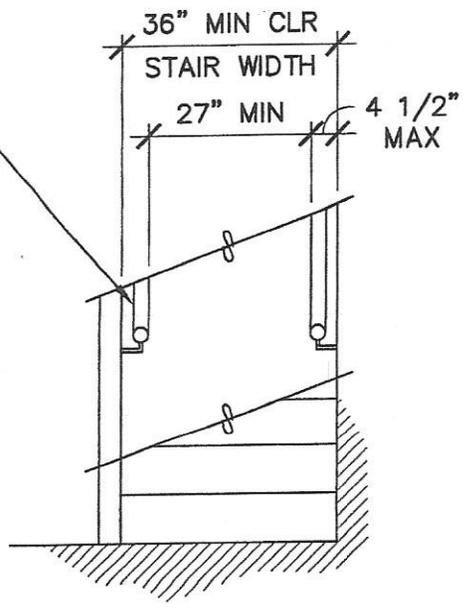

ELEVATION



OREGON RESIDENTIAL SPECIALTY CODE STAIR REQUIREMENTS